


ATTACHMENT D

PWTP Chlorine Room – Current Condition Pictures



TGO TECHNOLOGIES, INC.
TOTAL CONTAINMENT
SYSTEM
Santa Rosa, California
(800) 543-6603
Patent number: 5,607,384

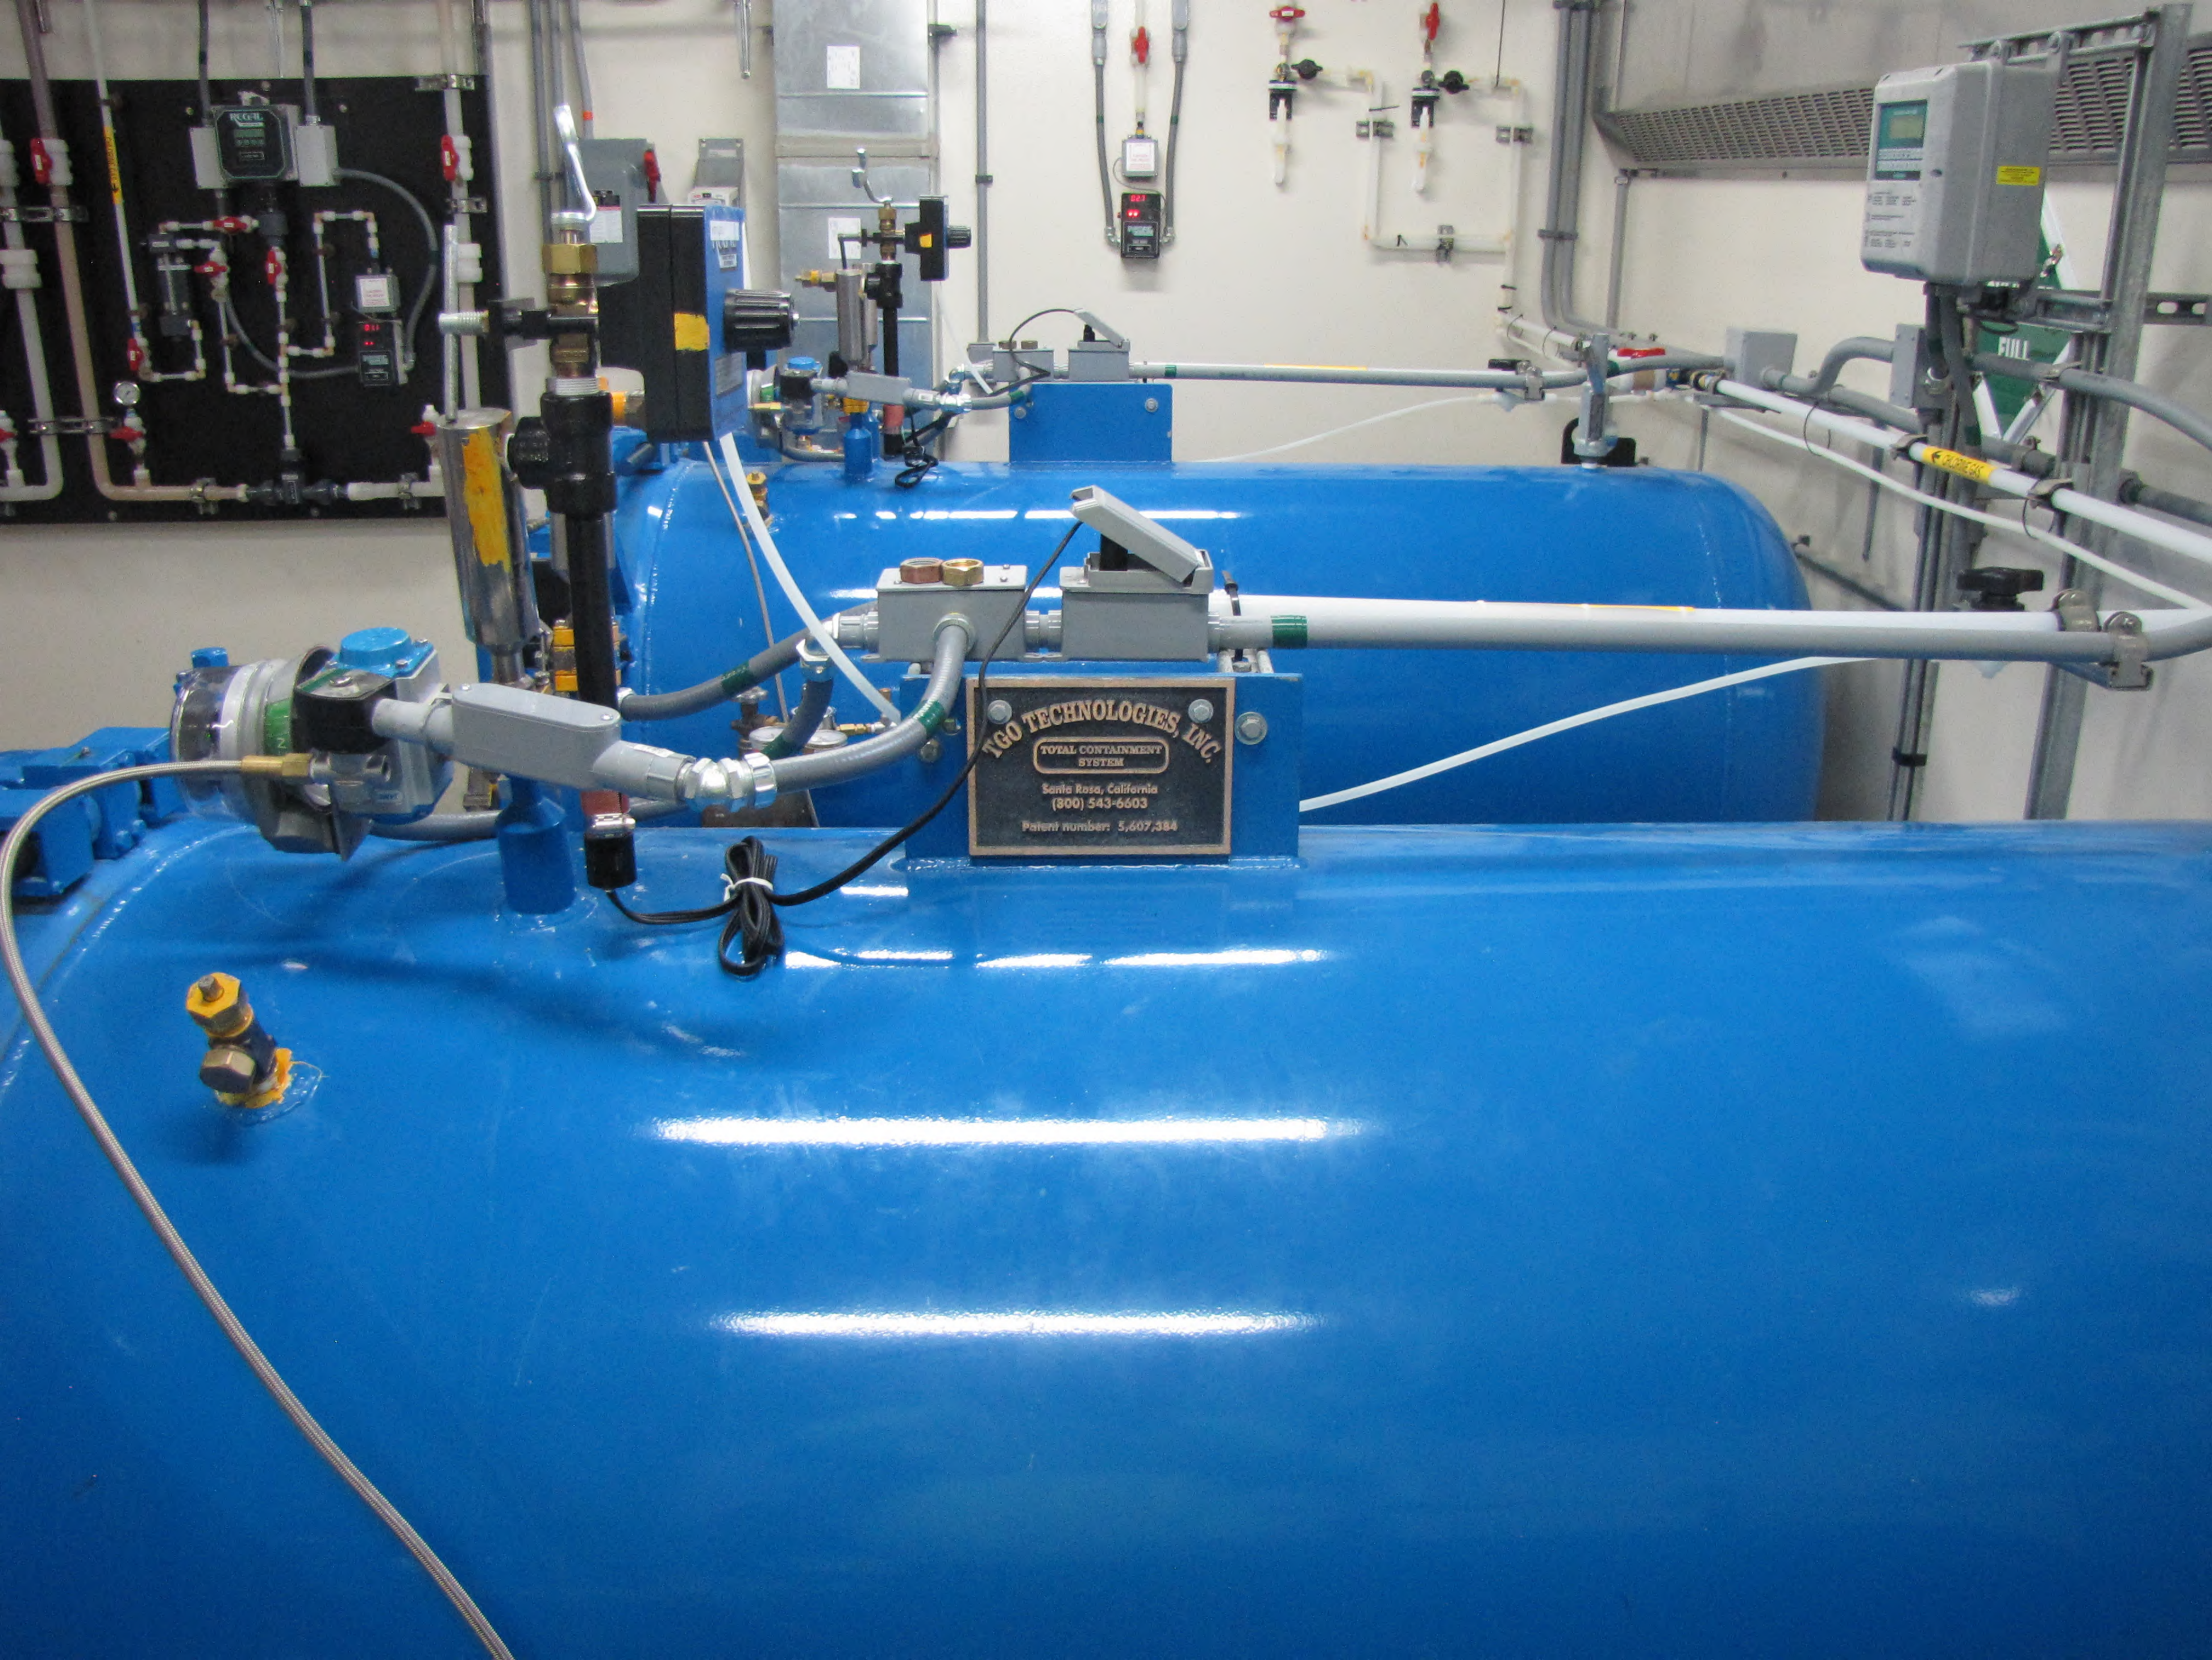

INHALATION HAZARD 2

INHALATION HAZARD 2

INHALATION HAZARD 2

CYLINDER

CYLINDER IN USE

CYLINDER IN USE

GLYCOL RETURN

GLYCOL SUPPLY

enig4



UNDER
FULL



CHLORINE GAS

CHLORINE GAS

KEEP PLUGGED
IN





CYLINDER

GLYCOL RETURN

GLYCOL SUPPLY



CHLORINATED WATER

CHLORINATED WATER

UV TREATED WATER

UV TREATED WATER

CHLORINE GAS

REGAL
1.500

REGAL
1.500

0.25

0.11

1

1

1

1

1



REBUILT MAY 2020

VENT

A3 2

CAMTEX

1/2" DIA. 1/2" WALL TH. 1901 TO 89 2003 1118 04 14W E S 2411000001

VENT





↔ GLYCOL SUPPLY ↔

↔ GLYCOL RETURN ↔

FIRE

Electrical components including a fire alarm control panel, a fire alarm horn, a fire alarm bell, and various electrical boxes and conduits.





GLYCOL SUPPLY

GLYCOL RETURN



HAZARD
2

EXIT



GLYCOL RETURN

GLYCOL SUPPLY







